

GUIDANCE FOR THE STORAGE OF HOT AMMONIUM NITRATE SOLUTIONS



2005 Edition
Issue 2014



GUIDANCE FOR THE STORAGE OF HOT AMMONIUM NITRATE SOLUTIONS

Contents

1. INTRODUCTION	4
2. SCOPE AND PRINCIPLES	4
3. PROPERTIES OF HOT CONCENTRATED SOLUTIONS OF AMMONIUM NITRATE	5
3.2. Chemical Properties	6
3.3. Environmental Aspects	8
3.4. Health Hazards	8
4. LOCATION , DESIGN AND INSTRUMENTATION	9
4.3. Tank Design	9
4.4. Instruments, Controls and Accessories	11
4.5. Typical Storage Tank Layout	15
5. OPERATION	16
5.2. Normal Operation	16
5.3. Operation Under Upset Conditions	17
6. MAINTENANCE	22
6.2. Mechanical Integrity and Repairs	22
7. SAFETY EQUIPMENT	23
8. PERSONNEL TRAINING , FIRST AID AND EMERGENCY PLANS	23
9. REGULATIONS	24
10. REFERENCES	25
 APPENDIX 1 (SAFETY DATA SHEET)	 26
1. IDENTIFICATION OF THE PRODUCT AND THE COMPANY	26
2. HAZARDS IDENTIFICATION	27
3. COMPOSITION/ INFORMATION ON INGREDIENTS	28
4. FIRST-AID MEASURES	29
5. FIRE-FIGHTING MEASURES	30
7. HANDLING AND STORAGE	31
8. EXPOSURE CONTROL/ PERSONAL PROTECTION	32

9. PHYSICAL AND CHEMICAL PROPERTIES	33
10. STABILITY AND RECREATIVITY	35
11. TOXICOLOGICAL INFORMATION	36
12. ECOLOGICAL INFORMATION	37
13. DISPOSAL CONSIDERATIONS	38
14. TRANSPORT INFORMATION	39
15. REGULATORY INFORMATION	40
16. OTHER INFORMATION	41

DISCLAIMER:

This document has been produced for the benefit of the members of Fertilizers Europe. The information and guidance provided in this document is given in good faith. Fertilizers Europe, its members, consultants and staff accept no liability for any loss or damage arising from the use of this guidance. As regulations are up-dated from time to time, readers are advised to consult the up-to-date information.

Edition 2005

Issue 2014

© Fertilizers Europe 2014

1. INTRODUCTION

This guidance is one of several published by Fertilizers Europe in order to promote safety in the fertilizer industry. It replaces the previous one, which was issued by the industry associations IFA/APEA in 1985 (Ref. 1). It is much more detailed and takes into account the findings of the recent research work carried by TNO, a research organisation located in the Netherlands.

TNO, at the request of Fertilizers Europe, investigated the safety aspects of ammonium nitrate solutions at high temperatures and reported in 2003 (Ref. 2). The Fertilizers Europe steering group overseeing this work saw the opportunity as well as the necessity to follow up this project with the preparation of a more detailed guidance for the safe storage of hot ammonium nitrate solutions. This guidance seeks to translate the pertinent results of the Fertilizers Europe/TNO investigation into practical recommendations and also to encompass the results of intensive discussions within the steering group.

2. SCOPE AND PRINCIPLES

This guidance concerns the storage of hot ammonium nitrate solutions with a concentration in excess of 80% in fixed tanks. The recommendations are not intended for tanks used as process vessels in manufacturing plants. This guidance may also serve to determine the basic safety concept in performing safety studies and the design of storage tanks related to hot ammonium nitrate solutions.

This guidance is intended to apply to new installations but consideration must be given to adapting existing installations wherever reasonably practicable. It must also be borne in mind that not all recommendations may apply in every situation and retrofitting or modifying existing installations may not always be possible from a technical or practical point of view. In such cases appropriate safety studies should be carried out to establish that the existing situation is acceptable.

The guidance is not prescriptive in nature but provides a series of recommendations. It attempts to describe the relevant factors, their relative importance and various options available to specific situations.

This guidance addresses various safety related aspects of the storage of ammonium nitrate solutions, for example, location, design, construction, instrumentation, control systems and relief devices. It also briefly considers environmental aspects. In relation to safety it mainly covers:

- Location and construction features
- Design features concerning, for example, heating coils and venting methods
- Safety equipment and first aid measures
- Normal process conditions (e.g. temperature, pH)
- Upset conditions (monitoring and prevention)
- Decomposition reactions (e.g. detection by changes in temperature, pH and concentrations of N_2O , NO_x etc.)
- Intervention techniques such as the addition of water and/or ammonia and dumping of the tank contents into a safe area.

Local site conditions need to be taken into account in considering all the aspects described in this guidance.

The guidance briefly describes the physical and chemical properties of AN, focusing on the potential hazards of hot AN solutions. It also covers the main regulations, which apply to the production and storage of hot ammonium nitrate solutions in the European Union. Readers are advised to refer to up-to-date regulations as there may have been changes since the publication of this guidance.

3. PROPERTIES OF HOT CONCENTRATED SOLUTIONS OF AMMONIUM NITRATE

The main properties of relevance for AN storage are summarised below; further information is given in the Safety Data Sheet in Appendix 1. Much information on the physical and chemical properties and potential hazards of ammonium nitrate is available in literature (Ref. 3-6).

3.1. Physical Properties

Ammonium nitrate is very soluble in water. Heat is absorbed when it dissolves, which makes the process of dissolution difficult and slow at low temperatures.

The crystallisation temperatures as well as the atmospheric boiling points of AN solutions of different concentrations are given in the table on next page.

Crystallisation Temperatures and Boiling Points of AN Solutions AMMONIUM

AMMONIUM NITRATE (%)	80	82.5	85	87.5	90	92.5	95
Crystallisation temperature (°C)	57	65	75	85	96	108	122
Atmospheric boiling point (°C)	128	132	136	140	146	155	168

More detailed information regarding the relationship of atmospheric pressure boiling and crystallisation temperatures of AN solution is given in Diagram 1.

3.2. Chemical Properties

Hot AN solutions should always be stored under neutral or alkaline conditions. It is common industrial practice to express the pH of an AN solution as that of a 10 wt% solution at 25°C. According to this practice the pH of a neutral AN solution is not 7 but is in the region of 4.5. Measuring the pH at different concentrations and/or temperatures will result in different values and these values need to be appropriately adjusted.


AN solutions themselves are neither combustible nor flammable. They are oxidizing in nature and thus can enhance the potential fire hazard of combustible material. They can react on contact with organic materials such as wood, oil or grease, in some situations after a delay.

Hot AN solutions are capable of thermal decomposition which is negligible under normal storage conditions. Decomposing ammonium nitrate solutions can evolve N_2O , brown nitrous fumes (NO_x), nitric acid vapours and NH_3 , some of which are toxic in nature and, therefore, should not be inhaled (see Section 8 below). Whereas most of the decomposition reactions are exothermic in nature, the dissociation reaction (into ammonia and nitric acid) is endothermic and is vapour-pressure-dependent.

The tendency to decompose is enhanced by high temperature, acidic conditions and the presence of contaminants containing ions of, e.g. Cl, Fe, Co, Ni, Cr, and Cu. AN solutions also react vigorously with zinc and zinc alloys (note that zinc is widely used in galvanised steel).

Diagram 1

Atmospheric pressure boiling and crystallisation temperatures of AN solution

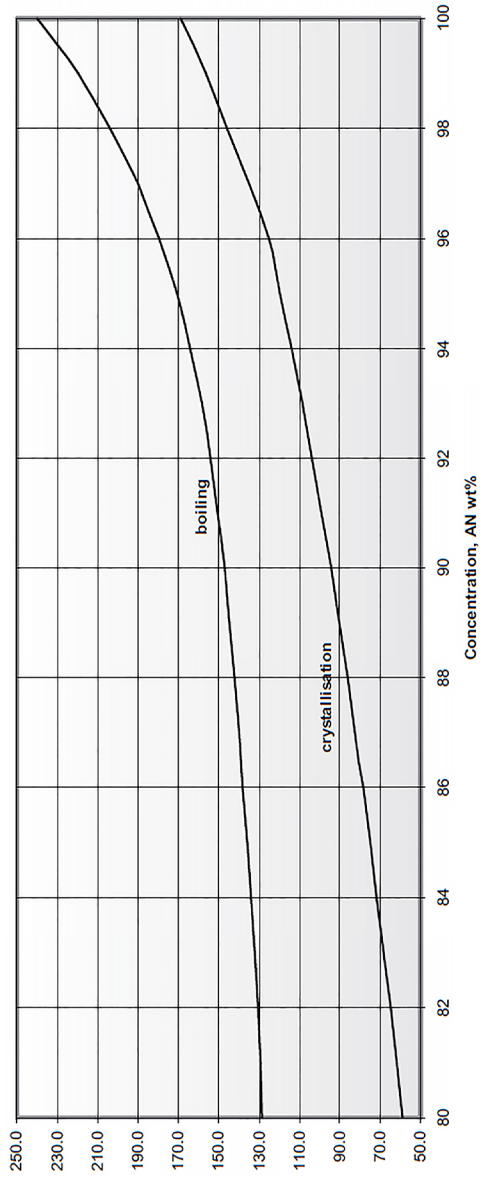

Once started, these reactions can become progressively more severe, unless controlled (see Section 5.3 below).

In this guidance the two types of reactions, decomposition/dissociation and oxidation, are described simply as decomposition.

Hot concentrated AN solution can give rise to a potential explosion hazard when heated under confinement (e.g. in a blocked pipe) or by severe shock derived from a high explosive or a high velocity projectile.

3.3. Environmental Aspects

Ammonium nitrate has a low toxicity to aquatic life (see Safety Data Sheet in appendix 1). It is the free or non-ionised ammonia generated due to the dissociation (which tends to be small) of AN, which produces the toxic effects. Ammonium Nitrate is a nitrogen fertilizer. Heavy spillage may cause an adverse environmental impact such as eutrophication in confined surface waters, or nitrate contamination. AN is biodegradable and does not show any bioaccumulation phenomena.

3.4. Health Hazards

In respect of people, AN is generally considered to be of low toxicity through all major absorption routes. Hot concentrated solutions of AN can produce very severe burns on the skin. This is not only because of their high temperature but also because they attack the skin on account of their oxidizing properties (see Safety Data Sheet in Appendix 1). First aid details are given in Section 8 below.

A toxic hazard can arise from brown nitrous fumes given off by decomposing ammonium nitrate solutions. These fumes must not be inhaled and they can have an insidious and delayed effect (see Appendix 1).

Protective measures should be taken in case ammonia is present in the area near the storage tank, for example, due to over-ammoniation and local venting.

4. LOCATION , DESIGN AND INSTRUMENTATION

4.1. General

Safety studies shall be performed for all new installations. They should be reviewed on a regular basis (e.g. every few years).

During the safety study attention should be paid to other processes linked to the manufacture and storage of AN solution with special consideration to the risk of contamination.

4.2. Location

A tank for hot concentrated ammonium nitrate solution should not be located close to any storage of combustible materials, whether solid or liquid.

The location for an AN solution storage tank should be selected so as to minimise the risk of contamination by acids and by other non-compatible materials as indicated above in Section 3.2.

If road tankers or rail wagons are required to park near a tank, the parking area should be level and arranged in such a way that, in case of a leak, the hot solution does not run into a common drain where it might react violently with other materials. A sump should be provided at filling points so that any drips can be dealt with in a controlled manner. Wooden sleepers should not be used for railway lines in the loading area.

Care should be taken to prevent any vehicle colliding with a tank, its supports, or its pipeline supports, by the erection of barriers where necessary.

4.3. Tank Design

The tank should be constructed to an appropriate engineering standard and the material of construction, such as austenitic stainless steel 304L, shall be resistant to corrosion by hot concentrated ammonium nitrate.

The following behaviour of ammonium nitrate should be borne in mind when considering the design of a new tank with respect to diameter and height aspects. Tanks with a low height have the advantage of giving rise to a lower pressure head above the ammonium nitrate solution at the bottom of the tank. This reduces the boiling temperature and the associated decomposition rate at the bottom of the tank. On the other hand, a low height-to-diameter ratio could be disadvantageous from the point of view of the mixing of any added dilution water.

Care should be taken to avoid confined or semi-confined spaces within the tank and associated equipment which can potentially allow AN solution to be trapped. For example, avoid double skinned baffles inside the tank.

Thermal insulation, if applied, should be of inorganic material and should be checked to ensure there is no hazardous reaction of the material with hot ammonium nitrate solution.

The insulation should be protected and sealed by an outer skin of stainless steel or aluminium. Whichever is used, care should be taken to ensure that there are no gaps in the outer skin to prevent water entering which could reduce the efficiency of the insulation.

The number of flanges should be kept to a minimum and they should be outside the insulation of the tank.

There should be a facility such as a pump to circulate the solution in the tank to ensure a homogeneous solution. A minimum circulation rate should be considered for each individual tank and, in the absence of suitable calculation methods to specify this rate, a minimum circulation rate of about 5-10% of the tank volume per hour is recommended as a rough guide.

The tank should be provided with a secondary containment (e.g. bund wall). The area contained within the secondary containment must be free from reactive substances and from surface contamination to minimise the risk of AN decomposition and associated toxic fume release if the solution leaks or there is a major loss of containment.

The tank should be provided with an overflow system with the discharge directed to a safe area. Care should be taken to avoid this line blocking due to crystallisation of the AN.

The materials used for the foundation underneath a tank should be devoid of a sensitising effect on ammonium nitrate to minimise the risk of decomposition in case of a leak of the ammonium nitrate solution.

The design should pay attention to the detection of leaks occurring due to corrosion, for example.

The interior of the tank shall be thoroughly cleaned after construction and before any internal repairs. The tanks shall be inspected and cleaned if necessary on completion of the repairs.

It should be noted that ammonium nitrate solutions, whether hot, cold, concentrated or dilute, can attack and cause damage to cement and concrete unless they are suitably protected.

Refer to Section 4.4 for the provision of instruments, controls and various accessories which should be considered when designing the tank.

The tank should be provided with a reliable water addition facility to cool and dilute the tank contents in case of a temperature rise e.g. caused by a decomposition of the AN solution in the tank.

4.4. Instruments, Controls and Accessories

Design standards concerning safety integrity

International guidelines have been developed for Safety Integrity Levels (SIL). The International Electrotechnical Commission (IEC) has issued:

- IEC 61508-SER “Functional safety of electrical/electronic/ programmable electronic safety-related systems” and
- IEC 61511-SER “Functional safety: Safety Instrumented Systems for the process industry sector”.

At the time of printing of this guidance the codes are not mandatory but it is expected that EU and national guidelines will be based on these. Readers are advised to consult these codes when designing AN solution storage systems.

Safety reviews of the individual plants can be used to determine the required SILs of safety instrumented functions (SIF) such as the water addition system activated by high temperature. It is outside the scope of this guidance to give detailed recommendations in this regard.

Level

The tank must be provided with reliable level measuring instruments capable of giving a continuous indication of level and high/low level alarms. In selecting the level instruments care must be taken for varying concentrations, densities and crystallisation temperatures of ammonium nitrate solutions.

Temperature

Multiple temperature sensors should be provided, preferably at different heights and around the circumference of the storage vessel. High temperature alarms/trips should be installed with set points at temperatures as close as practically possible to the operating temperature. The indicative range for such settings is 5-20°C above the normal operating temperature. The minimum operating temperature should be at least 5°C above the AN solution crystallisation temperature. A low temperature alarm should also be provided to warn of the risk of crystallisation.

Sampling

A means (e.g. a sampling valve) for obtaining a representative sample of the solution should be provided. Where necessary, a steam injection point for keeping the sampling lines clear should be installed.

Venting

A vent should be provided on the tank to prevent it from being put under excessive pressure or vacuum. Care should be taken to keep the vent free from blocking by proper design or by steam tracing or jacketing, where this is considered necessary.

The results of the Fertilizers Europe study relating to the release of decomposition gases including water vapour (also generated by water addition) should be taken into account. In order to provide a sufficient safety margin for the vent sizing, its capacity should be calculated corresponding to the credible worst-case scenario for the particular installation.

For example, a selected scenario involving a solution (100 tes) with a pH of 2 and chloride contamination of 100ppm leads to a vent size in the region of 250-300mm diameter. This takes account of the gases formed by decomposition as well as the gases from the evaporation of water, added at a rate sufficient to bring the temperature down from 180 to 150°C in one hour. The vent size is dependent on the rate of water addition.

Valves

Valves which do not trap the solution within the internals, are recommended for ammonium nitrate solution duty.

An automatic valve or a manual valve operable from a safe distance, may be considered for emptying the storage tank (see Section 5.3) as an alternative to water addition where water cannot be relied upon to be available. A drain valve should be provided to enable the tank to be emptied completely, where practicable.

Steam coil

A steam heating coil, or a circulation system incorporating a heat exchanger, may be provided to safeguard against low temperature conditions. The steam supplied shall be saturated and controlled so that the temperature of the ammonium nitrate solution does not exceed 150°C.

The following precautions are recommended for the steam supply system:

- The steam pressure in the coil should always be such that in case of a leak occurring in the coil the solution would not flow into the coil.
- The steam in the coil should preferably be on pressure control, not on temperature control in order to satisfy the above condition.
- The steam supply system should be fitted with protections to avoid the use of superheated or over-pressure steam.

Other control measures

Facilities for adding gaseous ammonia can be provided to correct the pH of the solution. This can be done either by direct injection or by circulation through another vessel which is equipped with the facilities for ammonia addition.

Pumps

Pumps are required to circulate the ammonium nitrate solution, to transfer the solution and to empty the storage tank.

They should be adequately protected to avoid pumping against a dead-end and overheating. Written procedures should be available for the design, operation and maintenance of these pumps. The pump system should be designed so as to minimise the risk of cavitation e.g. by means of a low level switch in the tank.

Pipework

The hardware and control systems linking the storage with the plant and exporting facilities (e.g. tanker loading) should be designed in such a way as to minimise the risk of contaminating the stored solution.

Unwanted pipe connections to the storage tank should be avoided in order to minimise the risk of contamination.

Pipe work should be steam jacketed or steam traced and/or insulated, as appropriate. It should be run with an adequate slope for drainage with drain valves at the lowest points. See above under steam coil for precautions relating to the steam supply.


AN solution lines can also be heated by electrical tracing as an alternative to jacketing or steam tracing. Heating by electrical tracing is generally not recommended as a permanent provision but if used, sufficient precautions should be taken. The tape should be the inherently safe, temperature-‘self-limiting’ type to avoid potential ‘hot-spots’. The maximum achievable temperature should not exceed the safe design temperature in the line; just as such a limit would be applied in the case of steam tracing. Independent measurements such as the temperature of the tracing tape and the electric current at the beginning and end of the tape should be used to ensure proper operation of the electrical tracing.

Care should be taken in design and modifications to prevent trapping ammonium nitrate in isolated sections. Steam/Condensate injection points should be provided to flush or clear the lines where appropriate.

Proper sealing should be provided, e.g. by using spiral-wound gaskets, to prevent the leakage of AN solution from flanges.

4.5. Typical Storage Tank Layout

Figure 1 is an illustrative drawing of a storage tank with its safety provisions. Different configurations and different degrees of automation can be envisaged depending on the local situation.

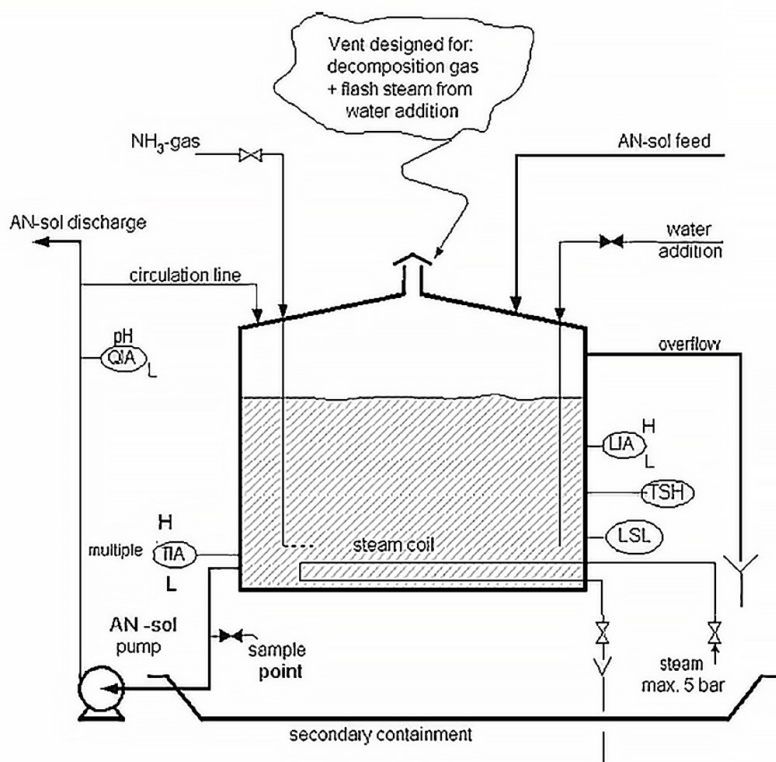

- QIA Quality Indicating Alarm (in this case: on-line pH measurement)
- TIA Temperature Indicating Alarm
- LIA Level Indicating Alarm
- TSH Temperature Switch High
- LSL Level Switch Low

Figure 1 – Illustrative drawing of a typical AN solution storage tank

5. OPERATION

5.1. General

The operation of the installation should be in accordance with written instructions. They should be available on the site, should cover the necessary safety precautions and include good house-keeping rules.

5.2. Normal Operation

Temperature monitoring and control

A maximum temperature of 150°C was recommended for the stored solution in the previous Guidance (Ref. 1). The results of the recent Fertilizers Europe project (Ref. 2) tend to support this limit.

The operating temperature of the AN solution shall be monitored and controlled to keep it below 150°C.

The minimum operating temperature should be at least 5°C above the AN solution crystallisation temperature.

pH monitoring and control

The pH of ammonium nitrate solutions should be regularly monitored and kept at neutral or alkaline i.e pH >4.5 (see Section 3.2).

AN solutions tend to lose ammonia gradually during storage. The more alkaline the solution the higher is the loss of ammonia.

Regular manual sampling and analyses or in-line continuous pH measurement shall be performed according to written procedures. The sample should be representative of the total content of the tank, e.g. by taking the sample from the circulation line. Such a sample should be taken and analysed at least once a day.

During unsteady plant operating conditions it will be necessary to increase the frequency of pH measurements. In particular if the AN solution is to be stored for a long period of time, e.g. during a plant shut-down, care should be taken to ensure that the monitoring of process conditions such as pH, temperature and concentration is continued.

NO_x and/or N₂O monitoring

On-line monitoring of these decomposition gases is an option for the early detection of decomposition.

Contamination

Regular analysis of the AN solution should be carried out to check for the required purity and safety (see Sections 4.1 and 9).

Precautions should be taken during operation and maintenance activities to prevent contamination of the storage facility. In particular, contamination of hot ammonium nitrate solution with oil (e.g. in the pumping area) is potentially dangerous.

Where there is a risk of accumulation of insoluble matter on the surface of the solution e.g. due to the presence of contamination in the feed streams, provision should be made for sampling the solution from the surface and the removal of any contaminated layer according to written procedures. The sampling should be done regularly depending on the nature of the process.

The storage area should be kept tidy and free from all rubbish.

5.3. Operation Under Upset Conditions

In situations where a decomposition is detected but an intervention is not possible, emptying the tank and containing the run-off may be considered. The risk of a runaway decomposition is thereby reduced because no pressure build up can take place. The ammonium nitrate solution will cool down and to some extent solidify and can be maintained without contamination of surface/ground water or soil. A safe collecting area should be provided.

Instructions for operators should be in place stating how to bring the AN-storage tank back to normal condition following upsets.

The typical main deviations are as follows:

- Temperature: high and low
- pH: high and low
- Level: high and low
- Contamination
- Blockage in the line and lack of circulation (i.e. no flow condition)
- Leakage
- Pressure: high and low

Temperature

High temperature conditions can arise as a result of e.g. AN solution feed at high temperature, malfunctioning of the heating system and decomposition.

In a high temperature situation one or more of the following actions may be taken:

- Isolate the heat input e.g. trip shut steam valve
- Stop the AN solution feed
- Add water (see details below)
- Add ammonia e.g. in the event of a decomposition

Low temperature conditions can arise as a result of e.g. cooler AN solution feed, loss of heating, inadvertent addition or ingress of water.

pH

Low pH conditions can arise due to e.g. a malfunction of the pH control system in the AN production unit or a loss of ammonia during storage.

In the event of a low pH situation one or more of the following actions may be taken:

- Add ammonia: normally a low pH is corrected by adding ammonia gas.
- Mix with AN solution of a higher pH.

High pH conditions can arise due to e.g. a malfunction of the pH control system in the AN production unit. This is not an unsafe condition as the solution will tend to lose ammonia gradually during storage. However, this could be an environmental issue e.g. a problem with ammonia odour in the vicinity.

Level

High or low level conditions usually arise due to a malfunction of the level instruments or mal-operation.

High level situations can lead to the overflow of the AN solution from the tank. Such overflow should be appropriately directed to minimise environmental implications. A low level condition may cause cavitation in the solution pump and may also lead to the steam coil not being covered with AN solution. The operator should investigate and take appropriate action.

Contamination

The presence of contamination may be indicated or suspected in a number of ways:

- Direct e.g. chemical analysis of the AN solution or visual inspection (e.g. suspended matter, coloration).
- Chemical analysis of the raw materials.
- Indirectly from the effects of the contamination on the solution e.g. temperature-rise, evolution of gases.

Appropriate action based on the nature and quantity of the contaminant must be taken in the event of the first two cases. In the third case, the consequential effects (e.g. temperature rise) need to be analysed by operators as there may be various possible causes.

If the consequential effects are likely to be associated with contamination, intervention measures must be taken to control the situation. These may include:

- The isolation of AN solution feed
- Identifying the source of contamination and prevention of further ingress
- The isolation of the heat input
- The addition of water (see details below).

Blockage in the line and lack of circulation

When a line gets blocked with crystallised AN, care must be taken to avoid heating the AN under confinement during any attempts to clear the blockage. Safe procedures must be followed which prevent this and the risk of personnel being sprayed and affected by the hot solution. Such procedures could involve, for example, opening up the line at one end and injecting hot condensate carefully to dissolve crystallised AN.

A potentially hazardous situation can arise in the pump due to lack of circulation as a result of line blockage and this can be detected by e.g. flow meter, pump low amps or temperature sensors. Under the no-flow situation the pump can overheat and may explode. Appropriate protection should be provided to avoid such a situation. In addition, the lack of circulation can also adversely affect the mixing of the AN solution in the tank.

Leakage

Leakages mainly occur from flanges and seals e.g. from the pump systems. Small leakages will lead to the solidification of the spilled ammonium nitrate but larger amounts may collect in pits and drains. These leakages should be properly managed.

Pressure

High pressure conditions may arise from decomposition gasses and from evaporated water in the course of intervention measures. Vents must be designed and installed for a credible worst case scenario (see Section 4.4).

Low pressure conditions can be avoided by the proper design of the vent system or vacuum relief valve, taking into account the highest possible off-take as well as a sudden cooling down of the vapour phase e.g. by the addition of cold water.

Addition of water in case of increasing temperatures

The addition of water can be initiated manually according to the operating procedures or may be triggered by an automatic trip/interlocking sequence. The use of this intervention technique shall be described in the operating instructions. The addition of water shall occur after reaching a specified temperature value (5-10°C above a selected alarm temperature, see Section 4.4).

Water may be added in various ways: on the top of the liquid surface; by means of a dip pipe (normal or perforated); or by means of a jet system. The risk of blockage occurring in the water line due to crystallisation of AN should be considered and should be addressed, where necessary, for example, by the provision of a small continuous flow of water in the pipe/jet.

Whichever method of water addition is used, consideration should be given to the effectiveness of its mixing with the AN solution for controlling the reaction within the available time (see below).

The spraying of ambient temperature water into the free space above the liquid in the storage vessel is not a preferred option as it can present the risk of a rapid condensation of vapour, which can create a vacuum inside the storage tank possibly causing damage. The tank has to be provided with adequate vacuum relief capacity against this hazard.

Sufficient free space between the maximum filling level and the overflow position in the storage vessel should always be kept to accommodate any liquid swell which may be caused by the flash steam produced when water is added.

A reliable source for the dilution water is essential. Water can be provided from a static head tank, a local water network or a fire fighting water system. If a pump is used, a back-up power supply is recommended to safeguard against power failure.

Water used for emergency actions should preferably be free from contaminants. However, in the selection of the water source, consideration should be given to the reasonable and reliable availability and the associated practical aspects.

Time available for response

The Time to Maximum Rate (TMR) depends on various factors, such as the type and quantity of contaminants as well as the AN concentration and solution temperature. In the Fertilizers Europe study the kinetic rates of decomposition of AN solutions which were acidified and contained selected contaminants, were found to be relatively low in the typical operating temperature range 130-150°C. For example, the results of the Dewar experiments with predefined contamination levels (under fairly pessimistic scenario conditions: 94% AN solution at pH 2 and containing 100ppm chloride contamination), show that the time for the temperature to rise from about 160°C to the temperature corresponding to maximum rate is about 5-6 hours. This means that in industrial situations there would be sufficient time available to intervene during a decomposition reaction before it could develop into a dangerous escalation.

6. MAINTENANCE

6.1. Regular Cleaning and Inspection of Storage Tanks

Empty and clean the tank at regular intervals particularly removing any deposits (e.g. corrosion products) that may have collected at the bottom of the tank. Thoroughly inspect and carry out any required maintenance work. The cleaning of the tanks should be performed according to a written procedure and be recorded. Where appropriate, the deposits should be analysed in order to identify their sources and to eliminate them where practicable.

Care should be taken to avoid cavitation when the tank is emptied using a pump.

The tank is usually cleaned with water and organic solvents are not recommended. Contact between organic solvents and ammonium nitrate shall be avoided. The tank shall be rinsed with clean water before commissioning.

6.2. Mechanical Integrity and Repairs

Inspection of the tanks should cover aspects of mechanical integrity and corrosion in addition to other aspects.

Valves, safety valves and other equipment should be checked periodically. If the steam coil has sprung a leak, it should be repaired. The damaged sections should not be isolated so as to avoid trapping and confining ammonium nitrate in the coil.

It is good practice to avoid patchwork when carrying out repairs. The damaged area should be cut out and replaced by a flush-fitting piece of new material. This is to avoid double plating which could cause ammonium nitrate to be trapped between the plates and its subsequent heating by the hot solution when the tank is put back in service. As stated in 3.2, under such conditions of heating and confinement, AN can give rise to an explosion hazard.

7. SAFETY EQUIPMENT

The following safety equipment should be provided on the site:

- A supply of water under pressure with hydrants and hoses, protected against frost in winter.
- An appropriate number of showers and eye wash devices.
- Protective clothing with a face screen available to be worn by operators before making connections, breaking connections, or breaking joints.
- Face shield or goggles, gloves, safety shoes or boots and protective aprons available to operating personnel. Operating instructions should specify the use of personal protection equipment.
- Breathing apparatus or escape sets to safeguard against any emission of toxic fumes.

8. PERSONNEL TRAINING , FIRST AID AND EMERGENCY PLANS

All personnel involved in the storage of the solutions must be given training about the potential hazards of AN, safe procedures to use for operation and maintenance and the precautions and actions to take in the event of an emergency e.g. fire, emission of toxic fumes, skin burning by hot solution.

Information on how to act in an emergency can be found in the safety data sheet for ammonium nitrate solution (see Appendix 1).

Emergency plans for potential scenarios such as fire and toxic fume release should be prepared, kept in a written form and should be regularly practised. The relevant records should be kept.

9. REGULATIONS

Information concerning current regulations at the time of preparation of this guidance (2005) is summarised below. Readers are advised to check for any revision and consult the most up to date legislation.

Seveso Directive

AN solution containing more than 80% AN is listed as a hazardous substance in the Seveso Directive (Ref. 7)

Classification, Packaging and Labelling Directive

Ammonium nitrate solutions are not classified as hazardous material according to the amended EEC Directive 67/548/EEC (Annex 1B of Directive 2004/73/EC) (Ref. 8).

UN Transport Regulations

International transport regulations e.g. UN Orange Book (Ref. 9), European rail, RID (Ref. 10), European road, ADR (Ref. 11) and international sea, IMDG (Ref. 12) classify hot ammonium nitrate solution containing more than 80% AN as an oxidizing substance, Class 5.1 UN No. 2426 (Ref. 9), with special provisions which specify the following safety related parameters:

- AN content not to exceed 93%
- to contain not more than 0.2% combustible material
- pH between 5 and 7 measured in an aqueous solution of 10% of the substance carried
- the maximum content of chloride ions should not exceed 0.02%

Readers are advised to consult the actual regulations for full and exact details.

10. REFERENCES

1. Safety Recommendations for the Storage of Hot Concentrated Ammonium Nitrate Solutions IFA/APEA Guidance 1985.
2. TNO report. Safety Aspects of ammonium nitrate solutions at high temperatures. November, 2003.
3. Shah, K. D. and Roberts, A. G., Chapters 11 and 15 in Nitric Acid and Fertiliser Nitrates. Fertiliser Science and Technology series. Volume 4 ed. C. Keleti, published by Marcel Dekker. ISBN 0-8247-7332-2.
4. Shah, K. D., (1996) Safety of Ammonium Nitrate Fertilisers. Proceedings 384, The International Fertiliser Society, York, UK
5. Guiochon, G., Thermal decomposition of pure ammonium nitrate, catalytic effects of various inorganic compounds Annals Chim. 5, (1960), 295-349
6. Bauer, A., King, A., and Heather, R. (1982). The Explosion Hazards of Ammonium Nitrate and Ammonium Nitrate Based Compositions – A Summary. A report published by the Department of Mining Engineering, Queen's University, Kingston, Canada.
7. Directive 2012/18/EU of the European Parliament and of the Council of 12 July 2012 on the control of major-accident hazards involving dangerous substances, amending and subsequently repealing Council Directive 96/ 82/ EC, OJ L 197, 24.7.2012, p. 1–37
8. Regulation (EC) No 1272/2008 of the European Parliament and of the Council of 16 December 2008 on classification, labelling and packaging of substances and mixtures, amending and repealing Directives 67/548/EEC and 1999/45/EC, and amending Regulation (EC) No 1907/2006.
9. UN Recommendation on the Transport of Dangerous Goods. Rev. 18, ISBN 978-92-1-139146-6 .
10. Convention concerning International Carriage by Rail (COTIF). Appendix B. Uniform Rules concerning the Contract for International Carriage of Goods by Rail (CIM). Annex I Regulations concerning the International Carriage of Dangerous Goods by Rail (RID). 2013 Edition.
11. European Agreement Concerning the International Carriage of Dangerous Goods by Road (ADR). Edition 2013. Volumes I and II. United Nations Publication ISBN 978-92-1-139143-5 (English).
12. International Maritime Dangerous Goods Code (IMDG) 2014 Edition.

APPENDIX 1

Safety Data Sheet



Hot Ammonium Nitrate Solution (80-93% w/w)

Conforms to Regulation (EU) No 453/2010

1. IDENTIFICATION OF THE SUBSTANCE/ MIXTURE AND OF THE COMPANY/ UNDERTAKING

1,1	Product identifier	<i>Company Input</i>
	Product/Trade name	Ammonium Nitrate (hot concentrated solution)
	Common chemical name	Hot Ammonium Nitrate Solution (HANS), ANS
	Synonyms	
	Chemical formula	Main ingredient: NH_4NO_3
	EU index number	Not listed.
	EC No.	Not applicable.
	CAS No.	Not applicable.
	REACH Registration Number	Not applicable, as the solution is a mixture.
	National Product Registration Number, where appropriate.	<i>Company Input</i>
1,2	Relevant identified uses of the substance or mixture and uses advised against	
	Use of the substance/mixture	Fertilizer, <i>Company Input (to be consistent with REACH Chemical Safety Report)</i>
	Uses advised against	<i>Company Input.</i>
1,3	Details of the supplier of the safety data sheet	
	Manufacturer/Importer/Supplier	<i>Company Input</i> Company name: Full address Tel.: + <i>Company Input (optional e.g. URL website & Email)</i>
	Email address of the person responsible for SDS	<i>Company Input</i> Email address
1,4	Emergency telephone number	<i>Company Input (include hours of operation)</i> <i>If a national official service exists, its number can be included.</i>

2. HAZARDS IDENTIFICATION

2.1	Classification of the substance or mixture	
	Classification in accordance with Regulation 1272/2008 (CLP)	Ox. Sol 3, H272 Eye Irrit. 2, H319
	Hazard statement(s)	H272 H319 May intensify fire; oxidiser. Causes serious eye irritation.
	Classification in accordance with Directive 67/548 (DSD)	O; R8, Xi; R36
	Risk phrase(s)	R8 R36 Contact with combustible material may cause fire. Irritating to eyes.
2.2	Label elements	Labelling in accordance with Regulation 1272/2008 (CLP)
	Hazard pictogram(s)	 
	Signal word	Warning
	Hazard statement(s)	H272 H319 May intensify fire; oxidiser. Causes serious eye irritation.
	Precautionary statement(s)	P210 P220 P280 P305+P351+P338 P370+P378 P337+P313 <i>Company Input: Fertilizers Europe recommendations</i> Keep away from heat, sparks, open flames & hot surfaces. — No smoking. Keep/Store away from combustible materials & chemicals. Wear eye protection. In case of fire: Use copious quantities of water. IF IN EYES: Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing. If eye irritation persists: Get medical attention. <i>Optional</i> Wash hands thoroughly after handling.

PBT/vPvB criteria	According to Annex XIII of Regulation (EC) No 1907/2006, no PBT and vPvB assessment has been conducted since ammonium nitrate is inorganic.
Other hazards which do not result in classification	
Physical and chemical hazards	Ammonium nitrate solution is not itself combustible but it can support combustion, even in the absence of air. On heating can cause decomposition, releasing toxic fumes containing nitrogen oxides and ammonia. Heating under strong confinement can lead to explosive behaviour.*
Health hazards	These solutions are dangerous because of their high temperature and possible chemical attack on the skin. Hot material can cause thermal burns to skin and eyes with risk of permanent damage. Ingestion is very unlikely; intake of large quantities may cause gastro-intestinal disorders; inhalation of mist and low concentrations of ammonia released from the hot solution may give rise to irritation of eyes, nose, throat and upper tract. No known adverse long term effects.*
Environmental hazards	Heavy spillage may cause adverse environmental impact such as eutrophication in confined surface waters or nitrate contamination. See Section 12.*

3. COMPOSITION/ INFORMATION ON INGREDIENTS

Chemical name	CAS no.	EC no.	Generic REACH Reg No.)	Classification Regulation (EC) No. 1272/2008	Classification Directive 67/548/EEC
Ammonium nitrate	6484-52-2	229-347-8	<i>Company Input</i>	Oxid. Solid 3, H272 Eye Irrit. 2, H319	O; R8 Xi; R36
Other ingredients					
<i>Company input e.g; diluents, additives, coatings</i>					
<i>EC no. means EINECS or ELINCS number.</i>					

*a mixture consists of more than one substances (independent of the REACH definition of the substances) (Borealis)

4. FIRST AID MEASURES

4,1	Description of first aid measures	<p>General In some cases medical attention necessary (see below). Ingress of hot solution by inhalation is most unlikely, however, if toxic vapours are inhaled: Remove from source of exposure. Obtain medical attention if ill effects occur.</p> <p>Ingestion This event is most unlikely because product is hot. Do not induce vomiting. Rinse mouth and then give water or milk to drink. Obtain medical attention if more than a small quantity has been swallowed.</p> <p>Skin contact Do not remove contaminated clothing (clothing might stick to the skin). Flush skin immediately with large amounts of cold water. If possible, submerge affected area in cold water and pack with ice. Obtain immediate medical attention.</p> <p>Eye contact Flush/irrigate eyes with copious amounts of water for at least 15 minutes. Remove contact lenses if present and easy to do so. Obtain medical attention if eye irritation persists.</p>	
4,2	Most important symptoms and effects, both acute and delayed	<p>Acute effects Eye irritation Delayed effects None known</p>	
4,3	Indication of any immediate medical attention and special treatment needed	<p>Note to physician Inhalation of fire and thermal decomposition gases, containing oxides of nitrogen and ammonia, can cause irritation and corrosive effects on the respiratory system. Some lung effects may be delayed. Give oxygen, especially if there is blueness around the mouth.</p>	

5. FIRE-FIGHTING MEASURES

5,1	Extinguishing media	Suitable extinguishing media	<p>If material is not directly involved in the fire. Use the best means available to extinguish the fire.</p> <p>If material is involved in the fire. Use plenty of water.</p>
5,2	Unsuitable extinguishing media	Unsuitable extinguishing media	Do not use chemical extinguishers or foams or attempt to smother the fire with steam or sand.
5,3	Special hazards arising from the substance or mixture	Special hazards	Potential explosion hazard under fire conditions when severely confined and/or contaminated with incompatible materials (e.g. organic materials, halogenated compounds - see Section 10)
	Specific hazards	Specific hazards	Do not allow hot ammonium nitrate to run into drains.
	Hazardous thermal decomposition and combustion products	Hazardous thermal decomposition and combustion products	Oxides of nitrogen, ammonia
5,3	Advice for firefighters	Advice for firefighters	
	Special fire fighting procedures	Special fire fighting procedures	<p>Cool down the containers/equipment exposed to heat with a water spray</p> <p>Open doors and windows of the store to give maximum ventilation.</p> <p>Avoid breathing the fumes (toxic); stand up-wind of the fire.</p> <p>Prevent any contamination of material by oils or other combustible materials.</p>
	Special protective equipment for fire-fighters	Special protective equipment for fire-fighters	Use a self-contained breathing apparatus if fumes are being entered.

6. ACCIDENTAL RELEASE MEASURES

6.1	Personal precautions, protective equipment and emergency procedures	Avoid walking through spilled product and exposure to fumes.
6.2	Environmental precautions	Take care to avoid the contamination of watercourses and drains and inform the appropriate authority in case of accidental contamination of watercourses.
6.3	Methods and material for containment and cleaning up	Wash small spillage with copious quantities of water. Contain large spillage with sand or earth as necessary or remove by pumping if possible and safe to do so. Allow material to solidify and scrape up. Place solidified material in suitable containers for recycle or disposal.
6.4	Reference to other sections	See section 1 for emergency contact information, section 8 for personal protective equipment and section 13 for waste disposal.

7. HANDLING AND STORAGE

The information in this section contains generic advice and guidance. The list of identified uses given in section 1 should be considered for any use-specific information provided in the Exposure Scenario(s).		
7.1	Precautions for safe handling	Avoid contamination by combustible (e.g. diesel oil, grease, etc.) and incompatible materials. Carefully clean all equipment prior to maintenance and repair.
7.2	Conditions for safe storage, including any incompatibilities	Locate away from the sources of heat or fire. The tank should be bunged to take the whole content of the tank. Keep away from incompatible materials mentioned under Section 10. Do not permit smoking and use of naked lights in the storage areas. Protect the tanks from corrosion and physical damages. Keep solutions above crystallisation temperature to prevent precipitation but they should not be allowed to exceed 150°C. (In transport 140°C as per IMDG Code). The pH of the solution should be kept above 4.5 (measured as a 10% solution).
7.3	Specific end use(s)	Company input

8. EXPOSURE CONTROLES/ PERSONAL PROTECTION

The information in this section contains generic advice and guidance. The list of identified uses given in section 1 should be considered for any use-specific information provided in the Exposure Scenario(s).			
8,1	Control parameters		
	Regulated Exposure limit values	No specific EU official limit. <i>Company input where hazardous ingredients may be present or where National Limits are specified.</i>	
	Recommended occupational and consumer exposure limit values (following from the performed CSA): For Ammonium nitrate	Exposure pattern Derived No Effect Level (DNEL) Workers General population Oral Not applicable Dermal 21.3 mg/kg bw/day Inhalation 37.6 mg/m ³ 11.1 mg/m ³ The long-term DNEL is considered sufficient to ensure that effects from acute exposure to the substance do not occur.	
	PNEC For Ammonium nitrate	fresh water: 0.45 mg/l marine water: 0.045 mg/l	Intermittent use/release: 4.5 mg/l Sewage treatment plant: 18 mg/l
8,2	Exposure controls	Avoid exposure to vapours and provide local exhaust ventilation where necessary. Provide safety showers and eye washing facility at any location where skin or eye contact can occur.	
	Appropriate engineering measures	Not applicable. (Contact with hot solution unlikely).	
	Hygienic measures	To protect against fumes wear suitable breathing apparatus e.g.masks equipped with filter type K, self contained breathing apparatus, or respirator with an appropriate filter (e.g. EN 143, 149, filters)	
	Individual protection	Wear chemical resistant, protective apron and boots.	
	Respiratory system	Wear impermeable and heat resistant gloves	
	Skin and body	Use chemical safety goggles e.g. EN 166 or full face mask EN 402.	
	Hands	Provision of containment eg. bunding	
	Eyes	Avoid the contamination of watercourses and drains and inform the appropriate authority in case of accidental contamination of watercourses.	
	Environmental exposure controls	Do not flush into surface water or sanitary sewer system.	

9. PHYSICAL AND CHEMICAL PROPERTIES

9,1	Information on basic physical and chemical properties									
Information on basic physical and chemical properties	Appearance	Hot (> 110°C) colourless clear liquid when free from crystals.								
	Odour	Weak ammonia odour.								
	Odour threshold	Not applicable.								
	pH	> 4.5 of a 10% w/w water solution.								
	Melting point/freezing point	Ammonium nitrate (%)	80	82.5	85	87.5	90	92.5	95	98
		Crystallization temperature (°C)	57	65	75	85	96	108	122	146
	Initial boiling point and boiling range	Ammonium nitrate (%)	80	82.5	85	87.5	90	92.5	95	98
		Atmospheric boiling point (°C)	128	132	136	140	146	155	168	203
	Flash point	Not applicable								
	Evaporation rate	Not available.								
Flammability (solid, gas)	Non flammable.									
Upper/lower flammability or explosive limits	Not applicable.									
Explosive properties	Not classified as an explosive; has high resistance to detonation. Sensitivity to detonation is increased by the presence of contaminants and/or high temperatures. Heating under strong confinement (e.g. in tubes or drains) may lead to a violent reaction or explosion especially if there is contamination by some of the substances mentioned under Section 4.6.									
Auto-ignition temperature	Not combustible.									
Decomposition temperature	Above approx. 170 °C									
Minimum ignition energy	Not applicable									
Oxidising properties	Can support combustion and oxidize, may intensify fire.									
Critical temperature	Not applicable									
Relative density	Not applicable.									

Density	Ammonium nitrate (%)	90	91	92	93
	Temperature °C	100	100	140	100
	Density g/cm ³	1.39	1.41	1.39	1.42
Loose bulk density	Not applicable				
Vapour pressure at 20°C	Not applicable, crystallises. Values for saturated solution at 100 °C: 39.6kPa (80%); 22.6kPa (89.9%).				

Vapour density	Not applicable
Partition coefficient (n-octanol/water)	Not applicable
Viscosity	Not available
Mean particle size	Not applicable
Water solubility	Pure ammonium nitrate: 1920 g/l at 20°C
Surface tension	Not available
Other information	<i>Company input, for example see below</i>
9,2	Miscibility
	Fat solubility
	Gas group
	Remarks
	Molecular weight 80 (For main ingredient ammonium nitrate)

10. STABILITY AND REACTIVITY

10.1	Reactivity	Stable under recommended storage and handling conditions (see section 7, handling and storage).
10.2	Chemical stability	Stable under recommended storage and handling conditions (see section 7, handling and storage).
10.3	Possibility of hazardous reactions	When heated, can decompose.
10.4	Conditions to avoid	Heating above 150°C (decomposes to gases). Contamination by incompatible materials. Acidic conditions. Sources of heat or fire close to the product. Heating under confinement. Welding or hot work on equipment or plant which may have contained AN solution without first washing thoroughly to remove all material. Crystallisation. Dewatering of solutions.
10.5	Incompatible materials	Combustible materials, reducing agents, acids, alkalis, sulphur, chlorates, chlorides, chromates, nitrites, permanganates, metallic powders and substances containing metals such as copper, nickel, cobalt, zinc and their alloys. For fire situations: see section 5.
10.6	Hazardous decomposition products	When strongly heated, it decomposes releasing toxic fumes (e.g. NO _x , ammonia) When in contact with alkaline materials may give off ammonia gas. When in contact with strong acids may give off nitrogen oxide gases.. See also Sections 2 and 9.

11. TOXICOLOGICAL INFORMATION

11.1	Information on toxicological effects	
Toxicokinetics, metabolism and distribution Acute toxicity		Not available
	Acute oral toxicity	Main ingredient
	Acute dermal toxicity	Ammonium nitrate
	Acute inhalation toxicity	Ammonium nitrate
Local effects		LD50: 2950 mg/kg bw (OECD 401)
		LD50: > 5000 mg/kg bw (OECD 402)
		LC50: > 88.8 mg/l (no guideline followed)
Skin sensitisation	Skin irritation	Product
	Eye irritation	Ammonium nitrate
Other		No critical or specific hazard.
		Irritating (OECD 405)
		Not sensitizing (OECD 429, with magnesium nitrate, nitric acid ammonium calcium salt, sodium nitrate)
		For ammonium nitrate
Sub-acute toxicity		Oral 28-day NOAEL ≥ 1500 mg/kg bw/day (OECD 422, with potassium nitrate)
		Oral 52-week NOAEL = 256 mg/kg bw/day (OECD 453, with ammonium sulfate)
		Inhalation 2-weeks NOAEL ≥ 185 mg/m3 (OECD 412)
Mutagenicity		Negative (OECD 471, 473, with nitric acid ammonium calcium salt)
		Negative (OECD 476, with potassium nitrate)
Reproductive toxicity		Oral 28-day NOAEL ≥ 1500 mg/kg bw/day (OECD 422, with potassium nitrate)
		Not carcinogenic (OECD 453, with ammonium sulfate)
Carcinogenicity		Adverse health effects are considered unlikely when the product is handled and used correctly.
Remarks		If large quantities are ingested may give rise to gastro-intestinal disorders.





12. ECOLOGICAL INFORMATION

12.1 Toxicity	Ammonium nitrate		
	Fish (short-term)		48-h LC50: 447 mg/l (no guideline followed)
	Fish (long-term)		No data
	Daphnia magna (short-term)		48-h EC50: 490 mg/l (no guideline followed, with potassium nitrate)
	Daphnia magna (long-term)		No data
	Algae		10-d EC50: > 1700 mg/l (seawater, no guideline followed, performed with potassium nitrate)
12.2 Persistence and degradability	Inhibition of microbial activity		3-h EC50: >1000 mg/l, NOEC: 180 mg/l (OECD 209, with potassium nitrate)
	Biodegradation	Standard test is not applicable as the substance is inorganic.	
	Hydrolysis	No hydrolysable group is present, will completely dissociate into ions.	
12.3 Bioaccumulative potential	Octanol-water partition coefficient (K _{ow})		Not relevant as the mixture is inorganic, but considered to be low (based on high water solubility)
	Bioconcentration factor (BCF)		Low potential for bioaccumulation (based on main ingredient)
12.4 Mobility in soil	Low potential for adsorption (based on main ingredient properties)		
12.5 Results of PBT and vPvB assessment	Very soluble in water. The NO ₃ ⁻ ion is mobile. The NH ₄ ⁺ ion is adsorbed by soil. According to Annex XIII of Regulation (EC) No 1907/2006, no PBT and vPvB assessment has been conducted since ammonium nitrate is inorganic.		
12.6 Other adverse effects	Heavy spillage may cause adverse environmental impact such as eutrophication in confined surface waters		

13. DISPOSAL CONSIDERATIONS

13.1	Waste treatment methods	In accordance with local and national regulations, disposed by landfill or incineration. Controlled biodegradation in waste water treatment is possible.
	Container	Containers should be cleaned by appropriate method and then re-used or disposed by landfill or incineration as appropriate, in accordance with local and national regulations. Do not remove label until container is thoroughly cleaned.
	Methods of disposal	Depending on degree and nature of contamination, when cold dispose of by use as fertilizer on farm, as raw material for liquid fertilizer, or to an authorised waste facility. Do not empty into drains; dispose of this material and its container in a safe way and in accordance with all applicable local and national regulations. See chapters 06 03 and 06 10 of the list of wastes (Commission decision 2000/532/EC)
	Package waste disposal	Not applicable.
<i>Note: see section 7 for safe handling and storage</i>		

14. TRANSPORT INFORMATION

	ADR/RID	ADN/ADNR	IMDG	ICAO/IATA
14.1 UN Number	UN 2426	UN 2426	UN 2426	UN 2426
14.2 UN Proper shipping name	Ammonium nitrate based fertilizer	Ammonium nitrate based fertilizer	Ammonium nitrate based fertilizer	Ammonium nitrate based fertilizer
14.3 Transport hazard class(es)	5,1	5,1	5,1	5,1
14.4 Packing group	Not applicable			
Label				
14.5 Environmental hazards	Not applicable.			
14.6 Special precautions for user	None.			
14.7 Transport in bulk according to Annex II of MARPOL 73/78 and the IBC Code	Not applicable.			

15. REGULATORY INFORMATION

15,1	Safety, health and environmental regulation/legislation specific for the substance or mixture	EC 2003/2003, 96/82 EC; Seveso Directive, <i>Company input</i> .
	Other regulations	Regulation EC 1907/2006 (REACH), EC 2003/2003, 96/82 EC. <i>Company input</i> .
15,2	Chemical safety assessment	In accordance with REACH Article 14, a Chemical Safety Assessment has been carried out for the main ingredient Ammonium Nitrate as a substance.

16. OTHER INFORMATION

<p>The information provided in this safety data sheet is correct to the best of our knowledge, information, and belief at the date of its publication. The information given is designed only as guidance for safe handling, use, processing, storage, transportation, disposal, and release and is not to be considered a warranty or quality specification. The information relates only to the specific material designated and may not be valid for such material used in combination with any other materials or in any proceed, unless specified in the text.</p>	
Classification in accordance with Regulation 1272/2008, as listed in Annex VI:	None.
Classification in accordance with Regulation 1272/2008, by self-classification based on the performed CSA	Ox. Sol 3, H272 Eye Irrit. 2, H319
Risk phrases	R8 Contact with combustible material may cause fire. R36 Irritating to eye.
Symbols	O oxidizing Xi irritant
Abbreviations and acronyms	Oxidizing solids category 3 (Ox. Sol 3) Eye irritation Category 2 (Eye Irrit. 2) <i>Company input</i>
Training advice	<i>Company input</i>
Date of previous SDS	<i>Company input</i>
Modifications in this version	<i>Company input</i>
References	EFMA/Fertilizers Europe Guidance documents, TFI HPV data; NOTOX gap analysis
Disclaimer	<p>The information in this Safety Data Sheet is given in good faith and belief in its accuracy based on our knowledge of the substance/preparation concerned at the date of publication. It does not imply the acceptance of any legal liability or responsibility whatsoever by <the Company> for the consequences of its use or misuse in any particular circumstances.</p>



product stewardship
fertilizers



Avenue E. van Nieuwenhuyse 4/6

B-1160, Brussels, Belgium

Tel: +32 2 675 3550

Fax: +32 2 675 3961

main@fertilizerseurope.com

www.productstewardship.eu
www.fertilizerseurope.com

twitter.com/FertilizersEuro



www.youtube.com/fertilizerseurope



www.facebook.com/fertilizerseuropepage



Group Fertilizers Europe

